



10 NOV. 1993

AN AMERICAN NATIONAL STANDARD



01 APR. 1993

Face-to-Face and End-to-End Dimensions of Valves

ASME B16.10-1992

(REVISION OF ASME/ANSI B16.10-1986)



The American Society of
Mechanical Engineers

345 East 47th Street, New York, N.Y. 10017

Date of Issuance: January 15, 1993

The 1992 edition of this Standard is being issued with an automatic addenda subscription service. The use of an addenda allows revisions made in response to public review comments or committee actions to be published as necessary; revisions published in addenda will become effective 6 months after the Date of Issuance of the addenda. The next edition of this Standard is scheduled for publication in 1997.

ASME issues written replies to inquiries concerning interpretations of technical aspects of this Standard. The interpretations will be included with the above addenda service. Interpretations are not part of the addenda to the Standard.

ASME is the registered trademark of The American Society of Mechanical Engineers.

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The Consensus Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed code or standard was made available for public review and comment which provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "rate," or "endorse" any item, construction, proprietary device, or activity.

ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable Letters Patent, nor assume any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations issued in accordance with governing ASME procedures and policies which preclude the issuance of interpretations by individual volunteers.

No part of this document may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.

Copyright © 1993 by
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS
All Rights Reserved
Printed in U.S.A.

ASME B16 COMMITTEE
Standardization of Valves, Flanges, Fittings, Gaskets, and Valve Actuators

[The following is the roster of the Committee at the time of approval of this Standard.]

OFFICERS

W. N. McLean, *Chairman*
R. A. Schmidt, *Vice Chairman*
J. Yarmush, *Secretary*

COMMITTEE PERSONNEL

W. L. Ballis, Columbia Gas Distribution Co., Columbus, Ohio
J. E. Batey, Union Carbide Corp., South Charleston, West Virginia
K. M. Bell, Underwriter's Laboratory, Inc., Northbrook, Illinois
M. L. Blair, US Coast Guard, Washington, D.C.
R. R. Brodin, Fisher Controls International, Inc., Marshalltown, Iowa
A. Cohen, Copper Development Association, New York, New York
W. C. Farrell, Jr., Consultant, Birmingham, Alabama
C. E. Floren, Mueller Co., Decatur, Illinois
D. R. Frikken, Monsanto Co., St. Louis, Missouri
M. W. Garland, Frick Co., Waynesboro, Pennsylvania
J. B. Hagan, ABS Americas, New Orleans, Louisiana
J. C. Inch, Mueller Brass Co., Hartsville, Tennessee
J. S. John, J Square Engineering Co., Houston, Texas
G. A. Jolly, Henry Vogt Machine Co., Louisville, Kentucky
W. G. Knecht, Anchor/Darling Valve Co., Williamsport, Pennsylvania
R. Koester, The William Powell Co., Cincinnati, Ohio
J. H. McCauley, Jr., James H. McCauley, Inc., Chicago, Illinois
W. N. McLean, Newco Valves, Palos Park, Illinois
A. F. Rhodes, Arnco Technology Trust, Houston, Texas
F. C. Rosch, Jr., Technicon Enterprises, Inc., Oley, Pennsylvania
R. A. Schmidt, Ladisch Co., Russellville, Arkansas
W. M. Stephan, Flexitallic Inc., Pennsauken, New Jersey
T. F. Shroud, Ductile Iron Pipe Research Association, Birmingham, Alabama
R. E. White, Repairs, Inc., South Bend, Indiana
D. A. Williams, Southern Company Services, Birmingham, Alabama

PERSONNEL OF SUBCOMMITTEE N — STEEL VALVES

W. N. McLean, *Chairman*, Newco Valves, Palos Park, Illinois
R. A. Koester, *Vice Chairman*, The William Powell Co., Cincinnati, Ohio
M. A. Weinstock, *Secretary*, ASME, New York, New York
E. A. Bake, Edward Valve, Inc., Raleigh, North Carolina
M. L. Blair, US Coast Guard, Washington, D.C.
D. R. Frikken, Monsanto Co., St. Louis, Missouri
R. A. Handschumacher, Handschumacher Associates, Saunterstown, Rhode Island
G. R. Icenogle, Fisher Controls International, Inc., Marshalltown, Iowa
J. S. John, J Square Engineering Co., Houston, Texas
G. A. Jolly, Henry Vogt Machine Co., Louisville, Kentucky
R. J. Kiessel, US NRC, Washington, D.C.

W. G. Knecht, Anchor/Darling Valve Co., Williamsport, Pennsylvania
F. R. O'Brien, Pacific Valves, Long Beach, California
G. J. Paptun, Yarway Corp., Blue Bell, Pennsylvania
F. C. Rosch, Jr., Technicon Enterprises, Inc., Oley, Pennsylvania
J. C. Thompson, E I DuPont De Nemours & Co. Inc., Newark, Delaware
F. C. Tsao, Department of Navy, Washington, D.C.
M. P. Zyne, Consultant, Birmingham, Alabama

CONTENTS

Foreword	iii
Standards Committee Roster.....	v
1 Scope.....	1
2 Definitions	2
3 Facings of Flanged Valves	4
4 Variations of Length Within a Class of Valves	4
5 Tolerances	5
Figures	
1 Flange Facings and Their Relationships	3
2 Welding Ends	4
Tables	
1 Class 125 Cast Iron Flanged and Class 150 Steel Flanged and Buttwelding End Valves, Face-to-Face and End-to-End Dimensions	6
2 Class 250 Cast Iron Flanged and Class 300 Steel Flanged and Buttwelding End Valves, Face-to-Face and End-to-End Dimensions	10
3 Class 400 Steel Flanged and Buttwelding End Valves, Face-to-Face and End-to-End Dimensions	14
4 Class 800 Cast Iron Flanged and Class 600 Steel Flanged and Buttwelding End Valves, Face-to-Face and End-to-End Dimensions	16
5 Class 900 Steel Flanged and Buttwelding End Valves, Face-to-Face and End-to-End Dimensions	18
6 Class 1500 Steel Flanged and Buttwelding End Valves, Face-to-Face and End-to-End Dimensions	20
7 Class 2500 Steel Flanged and Buttwelding End Valves, Face-to-Face and End-to-End Dimensions	22
8 Classes 125 and 250 Cast Iron and Classes 150 to 2500 Steel Wafer Type Valves, Face-to-Face Dimensions	23
9 Classes 25 and 125 Cast Iron and Classes 150 to 600 Steel Butterfly Valves, Face-to-Face Dimensions	24
10 Determination of Face-to-Face and End-to-End Dimensions of Flanged Valves Having Various Flange Facings.....	25
11 Classes 150 to 2500 Steel Valves Having End Flanges With Ring Joint Facings, End-to-End Dimensions	26
Annex	
A References.....	29
Interpretations	31

FACE-TO-FACE AND END-TO-END DIMENSIONS OF VALVES

1 SCOPE

1.1 General

This Standard covers face-to-face and end-to-end dimensions of straightway valves, and center-to-face and center-to-end dimensions of angle valves. Its purpose is to assure installation interchangeability for valves of a given material, type, size, rating class, and end connection. Face-to-face and center-to-face dimensions apply to flanged end valves with facings defined in paras. 2.3.1 and 2.3.2, and to other valves intended for assembly between flat face or raised face flanges. End-to-end dimensions apply to grooved end, buttwelding end, and flanged end valves with facings defined in para. 2.3.3. Center-to-end dimensions apply to buttwelding end and to flanged end valves with facings defined in para. 2.3.3.

In Tables 1 to 7, *A* or *D* in a column head denotes valves having flanged ends as illustrated; *B* or *E* denotes valves having buttwelding ends.

1.2 Standard Units

The inch is the standard for linear dimensions.¹ (For conversion to metric units, 1 in. = 25.4 mm.)

1.3 Cast Iron Valves

Only flanged end valves (and others intended for assembly between flanges) are covered by this Standard. Mating dimensions and facings of flanged ends conform to those in ASME/ANSI B16.1. Dimensional

¹Linear dimensions in this Standard are expressed using two-place decimal fractions. These values are actually common fractions of an inch rounded to the nearest two-place decimal value as follows:

0.03 = $\frac{1}{32}$	0.44 = $\frac{7}{16}$
0.06 = $\frac{1}{16}$	0.50 = $\frac{1}{2}$
0.12 = $\frac{1}{8}$	0.56 = $\frac{9}{16}$
0.16 = $\frac{1}{32}$	0.62 = $\frac{5}{8}$
0.19 = $\frac{3}{16}$	0.69 = $\frac{11}{16}$
0.22 = $\frac{7}{32}$	0.75 = $\frac{3}{4}$
0.25 = $\frac{1}{4}$	0.88 = $\frac{7}{8}$
0.31 = $\frac{5}{16}$	0.94 = $\frac{15}{16}$
0.38 = $\frac{3}{8}$	

tables for various types and sizes of valves are as follows.

1.3.1 Gate, Plug, and Check Valves

Class² 125 — Table 1
 Class 250 — Table 2
 Class 800 — Table 4

1.3.2 Globe and Angle Valves

Class 125 — Table 1
 Class 250 — Table 2

1.3.3 Wafer Swing Check Valves

Class 125 — Table 8
 Class 250 — Table 8

1.3.4 Butterfly Valves

Class 25 — Table 9
 Class 125 — Table 9

1.4 Ductile Iron Valves

Only flanged end valves (and others intended for assembly between flanges) are covered. Mating dimensions and facings of flanged ends conform to those in ASME/ANSI B16.42. Valves are rated Class 150 and Class 300. Dimensions can be found in the same tables as corresponding types of cast iron and steel valves.

1.5 Steel and Alloy Valves

This category includes carbon, alloy, and stainless steels, and the nonferrous materials listed in ASME/ANSI B16.34. It includes flanged, buttwelding, and grooved ends, as well as the types of valves intended for assembly between flanges. Mating dimensions and facings of flanged ends conform to those in ASME/ANSI B16.5, ASME B16.47, Series A or MSS SP-44. [For flanged end butterfly valves, refer to Note (3) of Table 9 for flange information.] For flangeless or wafer valves intended for assembly between flanges, refer to Tables 8 and 9 for flange information. Only

²For explanation of Class, see para. 2.2.

buttwelding end valves in rating classes 150 through 2500 are included in this Standard. Dimensional tables for various types and sizes of valves are as follows.

1.5.1 Gate, Globe, Angle, Check, Plug, and Ball Valves

Class 150	— Table 1
Class 300	— Table 2
Class 400	— Table 3
Class 600	— Table 4
Class 900	— Table 5
Class 1500	— Table 6
Class 2500	— Table 7

1.5.2 Y-Pattern Globe and Y-Pattern Swing Check Valves

Class 150	— Table 1
-----------	-----------

1.5.3 Wafer Knife Gate Valves

Class 150	— Table 8
-----------	-----------

1.5.4 Wafer Swing Check Valves

Classes 150 to 2500	— Table 8
---------------------	-----------

1.5.5 Butterfly Valves

Class 150	— Table 9
Class 300	— Table 9
Class 600	— Table 9

1.6 Exclusions

This Standard excludes threaded and socket welding end valves, and all types of copper alloy and aluminum alloy valves.

2 DEFINITIONS

2.1 Nominal Valve Size

2.1.1 Nominal Pipe Size (NPS). The size of a valve is the corresponding nominal size of pipe in which it is used. The stated number is used for designation and is not necessarily the same as the valve inside diameter or port diameter.

2.1.2 Reduced Port Sizes. Venturi gate valves conforming to API 597 and reduced port gate and ball valves conforming to API 6D are designated for size by two numbers, the first being the NPS of the valve ends, the second being the NPS of the port (seats, moving parts, etc.); e.g., NPS 6 × 4 designates a valve of end size NPS 6 with a port to match NPS 4. These valves, conforming to the referenced API specifications, shall have face-to-face or end-to-end dimensions corresponding to valves having the same size end

FACE-TO-FACE AND END-TO-END DIMENSIONS OF VALVES

connections; e.g., an NPS 6 × 4 valve shall have the face-to-face or end-to-end dimensions of an NPS 6 valve.

2.2 Pressure-Temperature Rating Number

Valves are designated as one of the following classes of pressure-temperature rating numbers:

- (a) Cast iron — Classes 25, 125, 250, 800
- (b) Ductile iron — Classes 150, 300
- (c) Steel³ — Classes 150, 300, 400, 600, 900, 1500, 2500

2.3 Flanged Valve Dimensions

2.3.1 Face-to-Face. The face-to-face dimension for flanged valves is the distance between the extreme ends which are the gasket contact surfaces (see Fig. 1). Face-to-face applies to flanged valves having the following flange facings:

- (a) flat
- (b) 0.06 in. raised
- (c) 0.25 in. raised
- (d) large or small male⁴
- (e) large or small tongue⁴

2.3.2 Installed Face-to-Face. The installed face-to-face dimension of certain butterfly valves [see Table 9, Note (1)] may include allowances for gasket or resilient-facing compression. Refer to MSS SP-67 for definitive illustrations.

2.3.3 End-to-End. For those flanged valves where the gasket contact surfaces are not located at the extreme ends of the valve, the distance between the extreme ends is described as the end-to-end dimension and applies to flanged valves having the following flange facings:


- (a) ring joint
- (b) large or small female
- (c) large or small groove

2.4 Buttwelding End Valve Dimensions (Also See Section 4)

For buttwelding end valves, the end-to-end dimension is the distance between the extreme ends (root faces) of the welding bevels (see Fig. 2).

³Includes all ferrous and nonferrous materials in ASME/ANSI B16.34.

⁴Face-to-face dimensions in Tables 1 to 7 must be adjusted as indicated in Table 10.

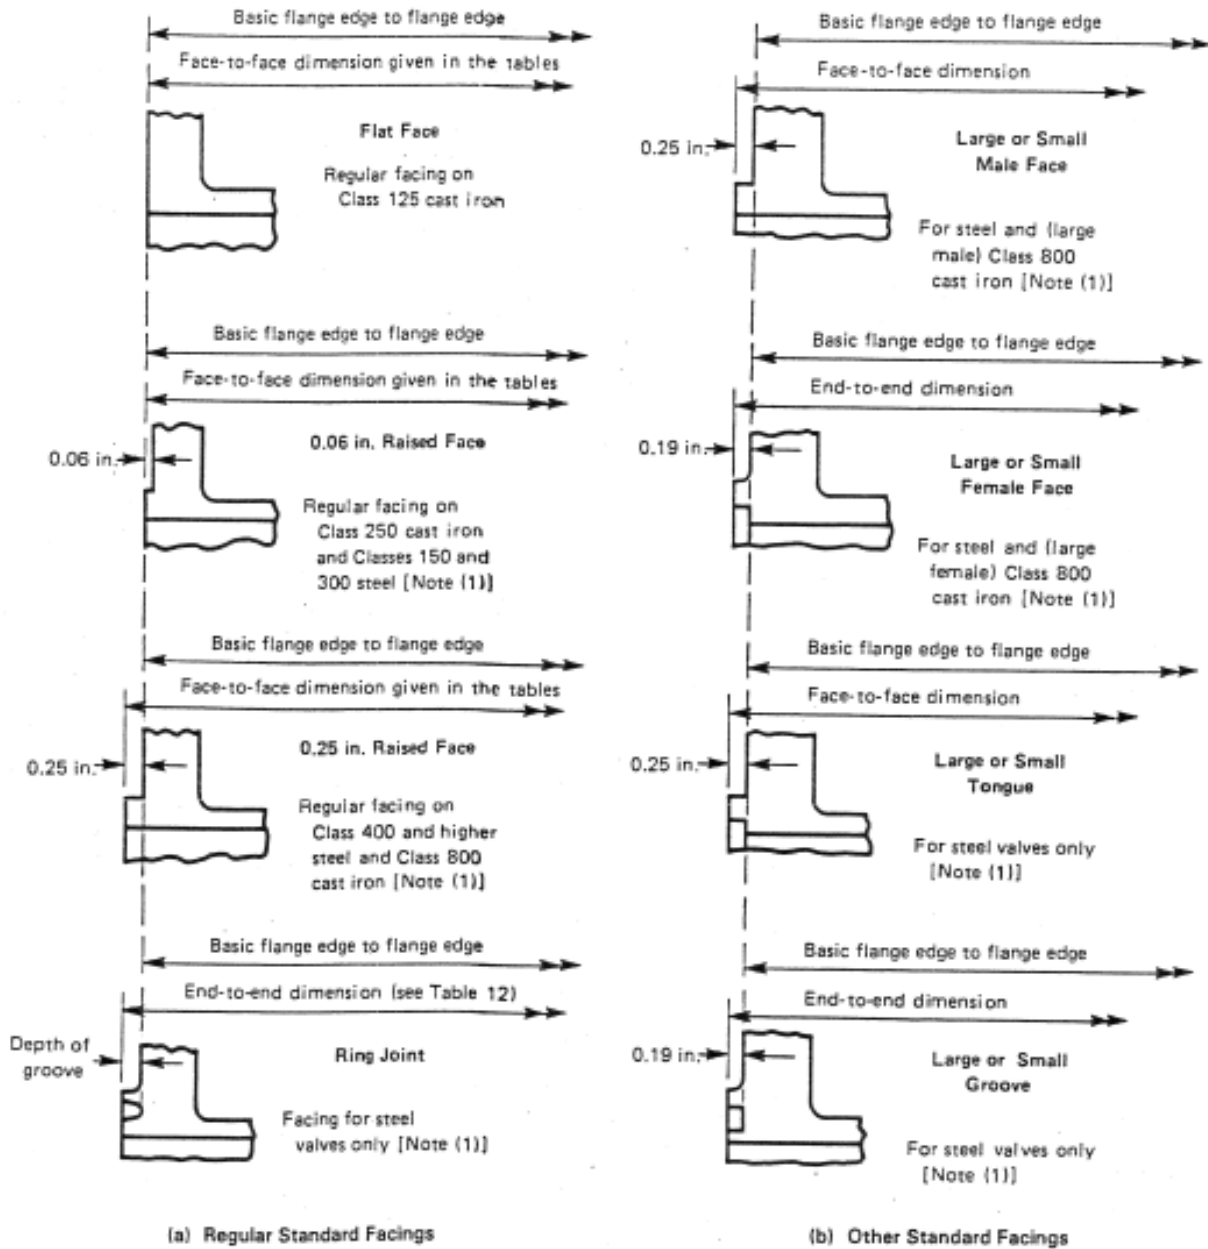


GENERAL NOTE:
Regular flange facings for valves are shown above. Valves normally carried in stock are so faced.

GENERAL NOTE:
Valves are supplied with the facings shown above when specified. See Table 10 to determine face-to-face dimensions of valves with these facings.

NOTE:
(1) Steel includes nonferrous materials in ASME/ANSI B16.34.

FIG. 1 FLANGE FACINGS AND THEIR RELATIONSHIPS

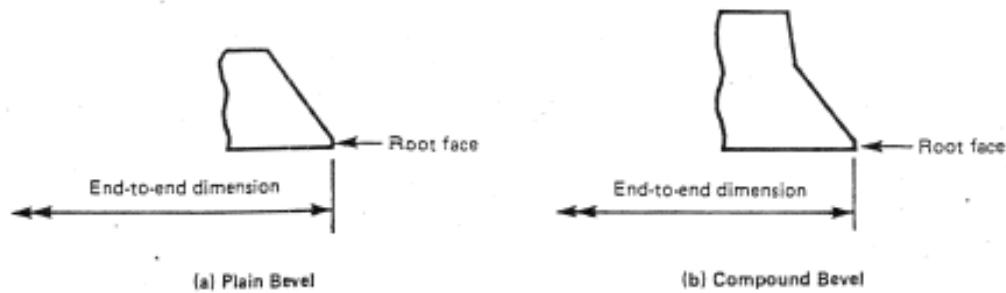

GENERAL NOTE:
Typical bevels are shown for illustration only.

FIG. 2 WELDING ENDS

2.5 Grooved End Valve Dimensions

The end-to-end dimension for grooved end valves is the distance between extreme ends.

2.6 Angle Valves

For flanged angle type valves (those in which the ends are at an angle of 90 deg to each other), the center-to-face dimension is the distance from the centerline of the port to the extreme end which is the gasket contact surface. For flanged angle type valves in which the gasket seating surface is not located at the extreme end and for angle type valves having butt-welding ends, the phrase center-to-end denotes the distance from the centerline of the port to the extreme end.

3 FACINGS OF FLANGED VALVES

Figure 1 shows facings for flanged ends.

3.1 Facings Normally Furnished

3.1.1 Flat Face. Flanges for Classes 25 and 125 cast iron valves are flat faced.

3.1.2 0.06 in. Raised Face. Flanges for Class 250 cast iron and for Classes 150 and 300 steel valves have 0.06 in. raised faces, which are included in the face-to-face (or center-to-face) dimensions. When Classes 150 and 300 valves are required with flat faces, either the full thickness of flange or the thickness with the 0.06 in. raised face removed may be furnished, unless otherwise specified by the customer. Users are reminded

that removing the 0.06 in. raised face will make the face-to-face dimension nonstandard.

3.1.3 0.25 in. Raised Face. Flanges for Class 800 cast iron and for Class 400 and higher steel valves have 0.25 in. raised faces, which are included in the face-to-face (or center-to-face) dimensions.

3.2 Other Standard Facings

Table 10 summarizes data on all flange facings and can be used with Tables 1 to 7 in calculating face-to-face and end-to-end dimensions of flanged valves having standard facings other than those described in para. 3.1.

3.3 Ring Joint Facings

The X dimension given in Table 11, when added to the face-to-face dimension of a valve having raised face flanges in Tables 1 to 7, establishes the end-to-end dimension for the valve having flanges with ring joint facings.

4 VARIATIONS OF LENGTH WITHIN A CLASS OF VALVES

4.1 Butt-welding End Valves (Also see para. 2.4)

Tables 1 to 7 include end-to-end dimensions for valves having butt-welding ends. In many cases, the dimensions are different from those of face-to-face dimensions of flanged valves, as evidenced by the differences between dimensions A and B of the tables.

4.1.1 Short Pattern

For pressure seal or flangeless bonnet valves having buttwelding ends in Class 600 and higher, the regular end-to-end dimensions shall be equal to the short pattern dimensions shown in Tables 4 to 7. At the manufacturer's option, the end-to-end dimensions of these valves may be the same as the face-to-face dimensions of raised face flanged valves.

4.1.2 Long Pattern

For flanged bonnet valves having buttwelding ends in Class 600 and higher, the regular end-to-end dimensions shall be equal to the face-to-face dimensions of raised face flanged valves shown in Tables 4 to 7. At the manufacturer's option, the end-to-end dimensions may be the same as the short pattern end-to-end dimensions.

4.2 Narrow, Wide, and Extra Wide Designations

Certain butterfly valves are designated narrow, wide, or extra wide for the purpose of consolidating a

diversity of manufacturer's lengths into two or three sets of dimensions for a given size. At the manufacturer's option, any of the two or three dimensions listed for a size may be used.

5 TOLERANCES

5.1 Straightway Valves

A tolerance of ± 0.06 in. shall be allowed on face-to-face and end-to-end dimensions of valves of NPS 10 and smaller, and a tolerance of ± 0.12 in. shall be allowed for NPS 12 and larger. For exceptions as related to wafer type and butterfly valves, see General Note (b) in Table 8 and Notes (4) and (5) in Table 9.

5.2 Angle Valves

The tolerances on center-to-face and center-to-end dimensions of angle type valves shall be one-half those listed in para. 5.1.

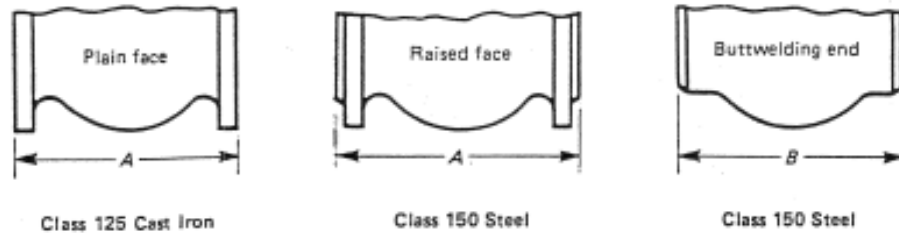


TABLE 1 CLASS 125 CAST IRON FLANGED AND CLASS 150 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

Nom. Valve Size, NPS	1	2	3	4	5	6	7	8	9	10
	Class 125 Cast Iron						Class 150 Steel			
	Flanged End (Flat Face)						Flanged End (0.06 in. Raised Face) and Welding End			
	Gate, Solid Wedge and Double Disc A	Plug			Globe, Lift Check, and Swing Check (1) A	Angle and Lift Check D	Gate		Plug	
Short Pattern A		Regular and Venturi Pattern A	Round Port, Full Bore A	Solid Wedge and Double Disc A			Conduit A	Solid Wedge, Double Disc, and Conduit B		Short Pattern A
1/4	4.00	...	4.00	...
3/8	4.00	...	4.00	...
1/2	4.25	...	4.25	...
3/4	4.62	...	4.62	...
1	...	5.50	5.50 (3)	5.50	5.00	...	5.00	5.50
1 1/4	6.50 (3)	6.00	5.50	...	5.50	...
1 1/2	...	6.50	6.50 (3)	6.50	6.50	...	6.50	6.50
2	7.00	7.00	7.50 (3)	7.50	8.00	4.00	7.00	7.00	8.50	7.00
2 1/2	7.50	7.50	8.25 (3)	8.25	8.50	4.25	7.50	7.50	9.50	7.50
3	8.00	8.00	9.00 (3)	9.00	9.50	4.75	8.00	8.00	11.12	8.00
4	9.00	9.00	9.00 (3)	12.00	11.50	5.75	9.00	9.00	12.00	9.00
5	10.00	10.00	14.00 (3)	15.00	13.00	6.50	10.00	...	15.00	10.00
6	10.50	10.50	15.50	18.00	14.00	7.00	10.50	10.50	15.88	10.50
8	11.50	11.50	18.00	22.00	19.50	9.75	11.50	11.50	16.50	11.50
10	13.00	13.00	21.00	26.00	24.50	12.25	13.00	13.00	18.00	13.00
12	14.00	14.00	24.00	30.00	27.50	13.75	14.00	14.00	19.75	14.00
14	15.00 (2)	...	27.00	...	31.00	15.50	15.00	15.00	22.50	...
16	16.00 (2)	...	30.00	...	36.00 (5)	18.00	16.00	16.00	24.00	...
18	17.00 (2)	...	34.00	17.00	17.00	26.00	...
20	18.00 (2)	...	36.00	18.00	18.00	28.00	...
22	20.00	30.00	...
24	20.00 (2)	...	42.00 (4)	20.00	20.00	32.00	...
26	22.00	22.00	34.00 (6)	...
28	24.00	24.00	36.00 (6)	...
30	51.00 (4)	24.00	26.00	36.00 (6)	...
32	28.00	38.00 (6)	...
34	30.00	40.00 (6)	40.00
36	63.00 (4)	28.00	32.00	40.00 (6)	...

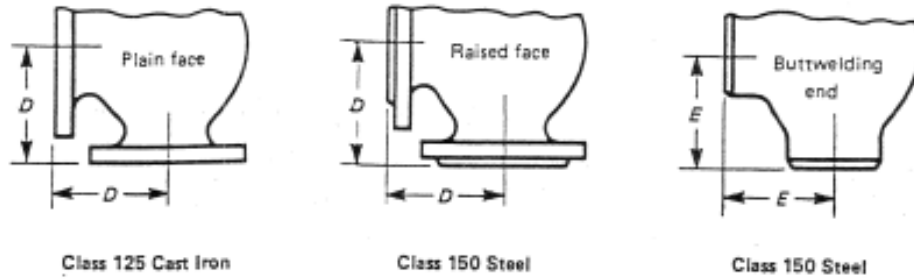


TABLE 1 CLASS 125 CAST IRON FLANGED AND CLASS 150 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

Nom. Valve Size, NPS	11	12	13	14	15	16	17	18	19	20	21
	Class 150 Steel										
	Flanged End (0.06 in. Raised Face) and Welding End							Flanged End		Welding End	
	Plug				Globe, Lift Check, and Swing Check (1) A and B	Angle and Lift Check D and E	Y-Globe and Y-Swing Check A and B	Ball			
	Regular Pattern A	Short and Regular Pattern B	Venturi Pattern A	Round Port, Full Bore A				Long Pattern A	Short Pattern A	Long Pattern B	Short Pattern B
1/4	4.00	2.00
3/8	4.00	2.00
1/2	4.25	2.25	5.50	4.25	4.25	...	5.50
3/4	4.62	2.50	6.00	4.62	4.62	...	6.00
1	7.00	5.00	2.75	6.50	5.00	5.00	...	6.50
1 1/4	5.50	3.00	7.25	5.50	5.50	...	7.00
1 1/2	8.75	6.50	3.25	8.00	6.50	6.50	7.50	7.50
2	...	10.50	7.00	10.50	8.00	4.00	9.00	7.00	7.00	8.50	8.50
2 1/2	...	12.00	...	11.75	8.50	4.25	11.00	7.50	7.50	9.50	9.50
3	...	13.00	8.00	13.50	9.50	4.75	12.50	8.00	8.00	11.12	11.12
4	12.00	14.00	9.00	17.00	11.50	5.75	14.50	9.00	9.00	12.00	12.00
5	15.00	15.00	14.00 (7)	7.00
6	15.50	18.00	15.50	...	16.00 (7)	8.00	18.50	15.50	10.50	18.00	15.88
8	18.00	20.50	18.00	...	19.50	9.75	23.50	18.00	11.50	20.50	16.50
10	21.00	22.00	21.00	...	24.50	12.25	26.50	21.00	13.00	22.00	18.00
12	24.00	25.00	24.00	...	27.50	13.75	30.50	24.00	14.00	25.00	19.75
14	27.00	...	27.00	...	31.00	15.50	...	27.00	15.00	30.00	22.50
16	30.00	...	30.00	...	36.00 (8)	18.00	...	30.00	16.00	33.00	24.00
18	34.00	...	34.00	...	38.50 (9)	34.00	...	36.00	26.00
20	36.00	...	36.00	...	38.50 (9)	36.00	...	39.00	28.00
22	42.00 (9)	43.00	...
24	42.00	...	42.00	...	51.00 (9)	42.00	...	45.00	32.00
26	51.00 (9)	49.00	...
28	57.00 (9)	53.00	...
30	60.00 (9)	55.00	...
32	60.00	...
34	64.00	...
36	77.00 (9)	68.00	...

(See Notes on p. 8)


TABLE 1 (CONT'D)

GENERAL NOTES:


- (a) Dimensions are in inches.
- (b) See Table 10 for adjustments to tabulated dimensions which may be required for certain flange facings.

NOTES:

- (1) These dimensions are not intended to cover the type of check valve having the seat angle at approximately 45 deg to the run of the valve, or the "Underwriter Pattern," or other patterns where large clearances are required.
- (2) Solid wedge only.
- (3) Regular pattern only. The face-to-face dimension of NPS 4 may be 12.00 at the manufacturer's option.
- (4) Venturi pattern only.
- (5) Globe and horizontal lift check only.
- (6) Double disc and conduit only.
- (7) Globe and horizontal lift check only. The face-to-face and end-to-end dimension for Class 150 steel flanged and buttwelding end swing check valves in NPS 5 is 13.00 and in NPS 6 is 14.00.
- (8) Globe and horizontal lift check only. The face-to-face and end-to-end dimension for Class 150 steel flanged and buttwelding end swing check valves in NPS 16 is 34.00.
- (9) Swing check only.




Class 250 Cast Iron
and Class 300 Steel




Class 300 Steel

TABLE 2 CLASS 250 CAST IRON FLANGED AND CLASS 300 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

Nom. Valve Size, NPS	1	2	3	4	5	6	7	8	9
	Class 250 Cast Iron						Class 300 Steel		
	Flanged End (0.06 in. Raised Face)						Flanged and Welding End		
	Gate, Solid Wedge and Double Disc A	Plug			Globe, Lift Check, and Swing Check A	Angle and Lift Check D	Ball		
		Short Pattern A	Regular Pattern A	Venturi Pattern A			Long Pattern A	Short Pattern A and B	Long Pattern B
1/2	5.50	5.50	...
3/4	6.00	6.00	...
1	6.25	6.50	6.50	...
1 1/4	7.00	7.00	...
1 1/2	7.50	7.50	7.50	7.50
2	8.50	7.25	8.50	...	10.50	5.25	8.50	8.50	8.50
2 1/2	9.50	8.00	9.50	...	11.50	5.75	9.50	9.50	9.50
3	11.12	9.25	11.12	...	12.50	6.25	11.12	11.12	11.12
4	12.00	10.50	12.00	...	14.00	7.00	12.00	12.00	12.00
5	15.00	...	15.25	...	15.75	7.88
6	15.88	14.88	16.75	15.88	17.50	8.75	15.88	15.88	18.00
8	16.50	...	19.75	16.50	21.00	10.50	19.75	16.50	20.50
10	18.00	22.38	23.50	18.00	24.50	12.25	22.38	18.00	22.00
12	19.75	25.50	28.00	19.75	28.00	14.00	25.50	19.75	25.00
14	22.50	30.00	30.00	22.50	30.00
16	24.00	33.00	33.00	24.00	33.00
18	26.00	36.00	36.00	26.00	36.00
20	28.00	39.00	39.00	28.00	39.00
22	44.00	43.00	...	43.00
24	31.00	45.00	45.00	32.00	45.00
26	49.00	...	49.00
28	53.00	...	53.00
30	55.00	...	55.00
32	60.00	...	60.00
34	64.00	...	64.00
36	68.00	...	68.00



Class 250 Cast Iron and Class 300 Steel



Class 300 Steel

TABLE 2 CLASS 250 CAST IRON FLANGED AND CLASS 300 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

Nom. Valve Size, NPS	10	11	12	13	14	15	16	17
	Class 300 Steel							
	Flanged End (0.06 in. Raised Face) and Welding End							
	Gate, Solid Wedge, Double Disc, and Conduit A and B	Plug				Globe and Lift Check A and B	Angle and Lift Check D and E	Swing Check A and B
Short and Venturi Pattern A		Short and Venturi Pattern B	Regular Pattern A	Round Port, Full Bore A and B				
1/2	5.50 (1)	6.00	3.00	...
3/4	6.00 (1)	7.00	3.50	...
1	6.50 (1)	6.25 (2)	7.50	8.00	4.00	8.50
1 1/4	7.00 (1)	8.50	4.25	9.00
1 1/2	7.50	7.50 (2)	9.50	9.00	4.50	9.50
2	8.50	8.50	10.50 (2)	...	11.12	10.50	5.25	10.50
2 1/2	9.50	9.50	12.00 (2)	...	13.00	11.50	5.75	11.50
3	11.12	11.12	13.00 (2)	...	15.25	12.50	6.25	12.50
4	12.00	12.00	14.00 (2)	...	18.00	14.00	7.00	14.00
5	15.00	15.75	7.88	15.75
6	15.88	15.88	18.00	15.88	22.00	17.50	8.75	17.50
8	16.50	16.50	20.50	19.75	27.00	22.00	11.00	21.00
10	18.00	18.00	22.00	22.38	32.50	24.50	12.25	24.50
12	19.75	19.75	25.00	28.00	38.00	28.00	14.00	28.00
14	30.00	30.00 (3)	30.00 (3)	30.00	33.00
16	33.00	33.00 (3)	33.00 (3)	33.00	34.00
18	36.00	36.00 (3)	36.00 (3)	36.00	38.50
20	39.00	39.00 (3)	39.00 (3)	39.00	40.00
22	43.00	43.00 (3)	43.00 (3)	43.00	44.00
24	45.00	45.00 (3)	45.00 (3)	45.00	53.00
26	49.00	49.00 (3)	49.00 (3)	49.00	53.00
28	53.00	53.00 (3)	53.00 (3)	53.00	59.00
30	55.00	55.00 (3)	55.00 (3)	55.00	62.75
32	60.00	60.00 (3)	60.00 (3)	60.00
34	64.00	64.00 (3)	64.00 (3)	64.00
36	68.00	68.00 (3)	68.00 (3)	68.00	82.00

(See Notes on p. 12)

TABLE 2 (CONT'D)

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) See Table 10 for adjustments to tabulated dimensions which may be required for certain flange facings.

NOTES:

- (1) Solid wedge only.
- (2) Plug — short pattern only.
- (3) Venturi pattern only.

Table 3 begins on next page.

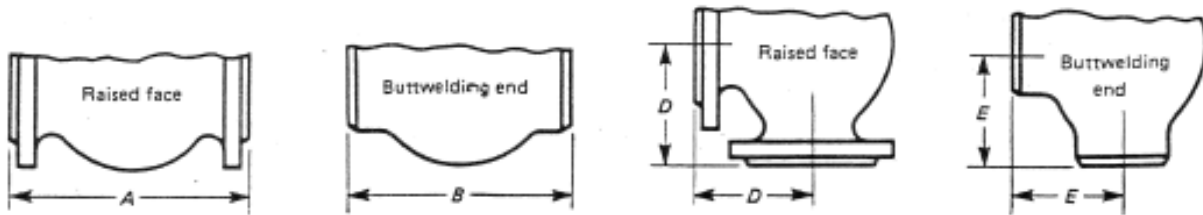


TABLE 3 CLASS 400 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

Nominal Valve Size, NPS	1	2	3	4	5	6	7
	Class 400 Steel						
	Flanged End (0.25 in. Raised Face) and Welding End						
	Gate, Solid Wedge, Double Disc, and Conduit A and B	Plug			Globe, Lift Check, and Swing Check A and B	Angle and Lift Check D and E	Ball
Regular and Venturi Pattern A and B		Round Port, Full Bore A	Round Port, Full Bore B	Long Pattern A and B			
1/2 (1)	6.50 (2)	6.50	3.25	6.50
3/4 (1)	7.50 (2)	7.50	3.75	7.50
1 (1)	8.50	8.50 (4)	10.00	...	8.50	4.25	8.50
1 1/4 (1)	9.00	9.00 (4)	9.00	4.50	9.00
1 1/2 (1)	9.50	9.50 (4)	12.50	...	9.50	4.75	9.50
2 (1)	11.50	11.50 (4)	13.00	...	11.50	5.75	11.50
2 1/2 (1)	13.00	13.00 (4)	15.00	...	13.00	6.50	13.00
3 (1)	14.00	14.00 (4)	17.50	...	14.00	7.00	14.00
4	16.00	16.00 (4)	19.00	22.00	16.00	8.00	16.00
5	18.00	18.00	9.00	...
6	19.50	19.50	24.00	28.00	19.50	9.75	19.50
8	23.50	23.50	29.00	33.25	23.50	11.75	23.50
10	26.50	26.50	35.00	35.00	26.50	13.25	26.50
12	30.00	30.00	40.00	40.00	30.00	15.00	30.00
14	32.50	32.50	35.00 (6)	...	32.50
16	35.50	35.50	35.50 (6)	...	35.50
18	38.50	38.50 (5)	40.00 (6)	...	38.50
20	41.50	41.50 (5)	41.50 (6)	...	41.50
22	45.00	45.00 (5)	45.00 (6)	...	45.00
24	48.50	48.50 (5)	55.00 (6)	...	48.50
26	51.50 (3)	51.50 (5)	55.00 (6)	...	51.50
28	55.00 (3)	55.00 (5)	63.00 (6)	...	55.00
30	60.00 (3)	60.00 (5)	65.00 (6)	...	60.00
32	65.00 (3)	65.00 (5)	65.00
34	70.00 (3)	70.00 (5)	70.00
36	74.00 (3)	74.00 (5)	82.00 (6)	...	74.00

(See Notes on p. 15)


TABLE 3 (CONT'D)

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) See Table 10 for adjustments to tabulated dimensions which may be required for certain flange facings.

NOTES:

- (1) The face-to-face dimensions and connecting end flanges for Class 400 valves, NPS 3 and smaller, are identical with those for Class 600 valves.
- (2) Solid wedge only.
- (3) Double disc and conduit only.
- (4) Regular pattern only.
- (5) Venturi pattern only.
- (6) Swing check only.

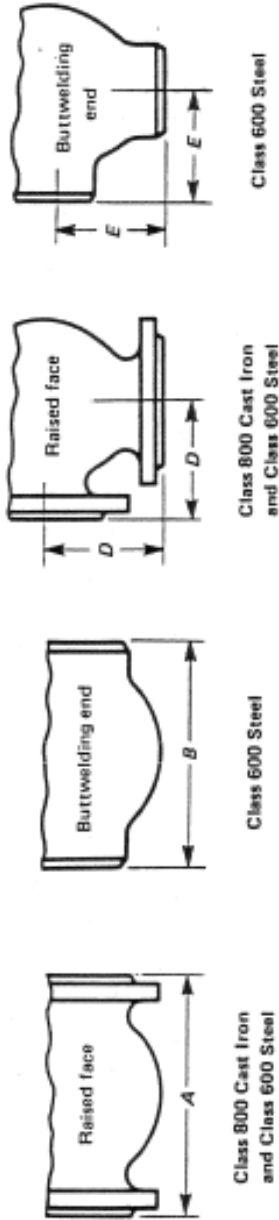

Class 600 Steel

Class 800 Cast Iron and Class 600 Steel

Class 600 Steel

Class 800 Cast Iron and Class 500 Steel

TABLE 4 CLASS 800 CAST IRON FLANGED AND CLASS 600 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

Nom. Valve Size, NPS	1	2	3	4	5	6	7	8	9	10	11	12	13
	Class 600 Steel												
Flanged End (0.25 in. Raised Face) and Welding End													
Flanged End (0.25 in. Raised Face)	Ball			Gate			Plug			Globe, Lift Check, and Swing Check, Short Pattern (1)		Globe, Lift Check, and Swing Check, Short Pattern (1)	Angle and Lift Check, Short Pattern (1)
	Gate, Solid Wedge and Double Disc A	Plug A	Swing Check A	Long Pattern A and B	Solid Wedge, Double Disc, and Conduit, Long Pattern A and B	Short Pattern (1) B	Regular and Venturi Pattern A and B	Round Bore, Full Port A	Round Bore, Full Port B	Globe, Lift Check, and Swing Check, Short Pattern (1) A and B	Globe, Lift Check, and Swing Check, Short Pattern (1) B	Angle and Lift Check, Long Pattern D and E	Angle and Lift Check, Short Pattern E
1/2	6.50	6.50 (2)	6.50	...	3.25	...
3/4	7.50	7.50 (2)	7.50	...	3.75	...
1	8.50	8.50	5.25	8.50 (4)	10.00	...	8.50	5.25	4.25	...
1 1/4	9.00	9.00	5.75	9.00 (4)	9.00	5.75	4.50	...
1 1/2	9.50	9.50	6.00	9.50	12.50	...	9.50	6.00	4.75	...
2	11.50	11.50	11.50	11.50	11.50	7.00	11.50	13.00	...	11.50	7.00	5.75	4.25
2 1/2	13.00	13.00	13.00	13.00	13.00	8.50	13.00	15.00	...	13.00	8.50	6.50	5.00
3	14.00	14.00	14.00	14.00	14.00	10.00	14.00	17.50	...	14.00	10.00	7.00	6.00
4	17.00	17.00	17.00	17.00	17.00	12.00	17.00	20.00	22.00	17.00	12.00	8.50	7.00
5	20.00	15.00	20.00	15.00	10.00	8.50

TABLE 4 CLASS 800 CAST IRON FLANGED AND CLASS 600 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS (CONT'D)

Nom. Valve Size, NPS	Class 600 Steel													
	Class 800 Cast Iron						Flanged End (0.25 in. Raised Face) and Welding End							
	1	2	3	4	5	6	7	8	9	10	11	12	13	
	Class 600 Steel													
	Flanged End (0.25 in. Raised Face)													
	Flanged End (0.25 in. Raised Face)			Ball		Gate		Plug			Globe, Lift and Swing Check, Short Pattern (1) B		Angle and Lift Check, Short Pattern (1) E	
	Gate, Solid Wedge and Double Disc A	Plug A	Swing Check A	Long Pattern A and B	Solid Wedge, Double Disc, and Conduit, Long Pattern A and B	Short Pattern (1) B	Regular and Venturi Pattern A and B	Round Bore, Full Port A	Round Bore, Full Port B	Globe, Lift and Swing Check, Long Pattern A and B	Globe, Lift and Swing Check, Short Pattern (1) B	Angle and Lift Check, Long Pattern D and E	Angle and Lift Check, Short Pattern (1) E	
6	22.00	22.00	22.00	22.00	22.00	18.00	22.00	26.00	28.00	22.00	18.00	11.00	10.00	
8	26.00	26.00	26.00	26.00	26.00	23.00	26.00	31.25	33.25	26.00	23.00	13.00	...	
10	31.00	31.00	31.00	31.00	31.00	28.00	31.00	37.00	40.00	31.00	28.00	15.50	...	
12	33.00	33.00	33.00	33.00	33.00	32.00	33.00	42.00	42.00	33.00	32.00	16.50	...	
14	35.00	35.00	35.00	35.00	35.00 (6)	
16	39.00	39.00	39.00	39.00	39.00 (6)	
18	43.00	43.00	43.00	43.00 (5)	43.00 (6)	
20	47.00	47.00	47.00	47.00 (5)	47.00 (6)	
22	51.00	51.00	...	51.00 (5)	51.00 (6)	
24	55.00	55.00	55.00	55.00 (5)	55.00 (6)	
26	57.00	57.00	...	57.00 (5)	57.00 (6)	
28	61.00	61.00	63.00 (6)	
30	65.00	65.00	...	65.00 (5)	65.00 (6)	
32	70.00	70.00 (3)	...	70.00 (5)	
34	76.00	76.00 (3)	...	76.00 (5)	
36	82.00	82.00 (3)	...	82.00 (5)	82.00 (6)	

GENERAL NOTES:

(a) Dimensions are in inches.

(b) See Table 10 for adjustments to tabulated dimensions which may be required for certain flange fittings.

NOTES:

- (1) These dimensions apply to pressure seal or flangeless bonnet valves. They may be applied at the manufacturer's option to valves with flanged bonnets.
- (2) Solid wedge only.
- (3) Double disc and conduit only.
- (4) Regular pattern only.
- (5) Venturi pattern only.
- (6) Swing check only.

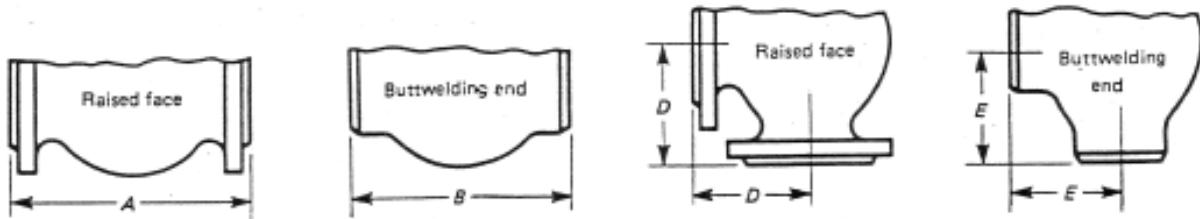


TABLE 5 CLASS 900 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

	1	2	3	4	5	6	7	8	9
Class 900 Steel Valves									
Flanged End (0.25 in. Raised Face) and Welding End									
Nom. Valve Size, NPS	Gate		Plug		Globe, Lift Check, and Swing Check, Long Pattern A and B	Globe, Lift Check, and Swing Check, Short Pattern (1) B	Angle and Lift Check, Long Pattern D and E	Angle and Lift Check, Short Pattern (1) E	Ball Long Pattern A and B
	Solid Wedge, Double Disc, and Conduit, Long Pattern A and B	Short Pattern (1) B	Regular and Venturi Pattern A and B	Round Port, Full Bore A					
3/4 (2)	9.00	...	4.50
1 (2)	10.00 (3)	5.50	10.00 (4)	...	10.00	...	5.00	...	10.00
1 1/4 (2)	11.00 (3)	6.50	11.00 (4)	...	11.00	...	5.50	...	11.00
1 1/2 (2)	12.00 (3)	7.00	12.00 (4)	14.00	12.00	...	6.00	...	12.00
2 (2)	14.50	8.50	14.50 (4)	15.00	14.50	...	7.25	...	14.50
2 1/2 (2)	16.50	10.00	16.50 (4)	17.00	16.50	10.00	8.25	...	16.50
3	15.00	12.00	15.00 (4)	18.50	15.00	12.00	7.50	6.00	15.00
4	18.00	14.00	18.00 (5)	22.00	18.00	14.00	9.00	7.00	18.00
5	22.00	17.00	22.00	17.00	11.00	8.50	...
6	24.00	20.00	24.00	29.00	24.00	20.00	12.00	10.00	24.00
8	29.00	26.00	29.00	32.00	29.00	26.00	14.50	13.00	29.00
10	33.00	31.00	33.00	38.00	33.00	31.00	16.50	15.50	33.00
12	38.00	36.00	38.00	44.00	38.00	36.00	19.00	18.00	38.00
14	40.50	39.00	40.50	39.00	20.25	19.50	40.50
16	44.50	43.00	44.50 (5)	...	44.50 (6)	43.00	26.00	...	44.50
18	48.00	48.00 (6)	...	29.00	...	48.00
20	52.00	...	52.00 (5)	...	52.00 (6)	...	32.50	...	52.00
22
24	61.00	61.00 (6)	...	39.00	...	61.00

(See Notes on p. 19)

TABLE 5 (CONT'D)

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) See Table 10 for adjustments to tabulated dimensions which may be required for certain flange facings.

NOTES:

- (1) These dimensions apply to pressure seal or flangeless bonnet valves. They may be applied at the manufacturer's option to valves with flanged bonnets.
- (2) The connecting end flanges for Class 900 valves, NPS 2½ and smaller, are identical to those of Class 1500 valves. The face-to-face dimensions for all Class 900 valves, NPS 2½ and smaller, except round port full bore plug valves (column 4), are identical with those of Class 1500 valves.
- (3) Solid wedge only.
- (4) Regular pattern only.
- (5) Venturi pattern only.
- (6) Swing check only.

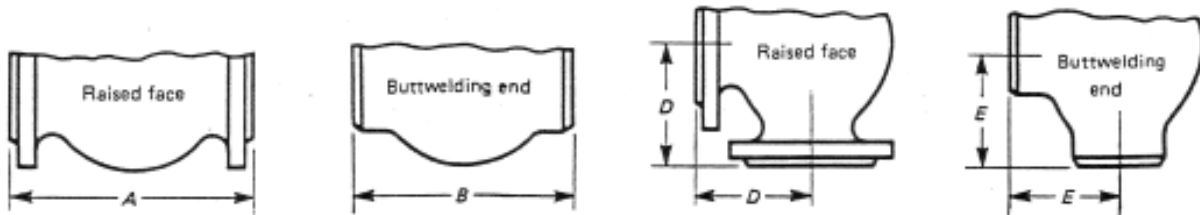


TABLE 6 CLASS 1500 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

Nom. Valve Size, NPS	1	2	3	4	5	6	7	8
	Class 1500 Steel							
	Flanged End (0.25 in. Raised Face) and Welding End							
	Gate		Plug		Globe, Lift Check, and Swing Check, Long Pattern A and B	Globe, Lift Check, and Swing Check, Short Pattern (1) B	Angle and Lift Check, Long Pattern D and E	Ball
	Solid Wedge, Double Disc, and Conduit, Long Pattern A and B	Short Pattern (1) B	Regular and Venturi Pattern A and B	Round Port, Full Bore A				
1/2	8.50 (5)	...	4.25	...
3/4	9.00	...	4.50	...
1	10.00 (2)	5.50	10.00 (3)	...	10.00	...	5.00	...
1 1/4	11.00 (2)	6.50	11.00 (3)	...	11.00	...	5.50	...
1 1/2	12.00 (2)	7.00	12.00 (3)	...	12.00	...	6.00	...
2	14.50	8.50	14.50 (3)	15.38	14.50	8.50	7.25	14.50
2 1/2	16.50	10.00	16.50 (3)	17.88	16.50	10.00	8.25	16.50
3	18.50	12.00	18.50 (3)	20.62	18.50	12.00	9.25	18.50
4	21.50	16.00	21.50 (3)	24.62	21.50	16.00	10.75	21.50
5	26.50	19.00	26.50	19.00	13.25	...
6	27.75	22.00	27.75	31.00	27.75	22.00	13.88	27.75
8	32.75	28.00	32.75	35.00	32.75	28.00	16.38	32.75
10	39.00	34.00	39.00	42.00	39.00	34.00	19.50	39.00
12	44.50	39.00	44.50	48.00	44.50	39.00	22.25	44.50
14	49.50	42.00	49.50	42.00	24.75	49.50
16	54.50	47.00	54.50 (4)	...	54.50 (6)	47.00	...	54.50
18	60.50	53.00	60.50 (6)
20	65.50	58.00	65.50 (6)
22
24	76.50	76.50 (6)

(See Notes on p. 21)

TABLE 6 (CONT'D)

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) See Table 10 for adjustments to tabulated dimensions which may be required for certain flange facings.

NOTES:

- (1) These dimensions apply to pressure seal or flangeless bonnet valves. They may be applied at the manufacturer's option to valves with flanged bonnets.
- (2) Solid wedge only.
- (3) Regular pattern only.
- (4) Venturi pattern only.
- (5) Globe and lift check only.
- (6) Swing check only.

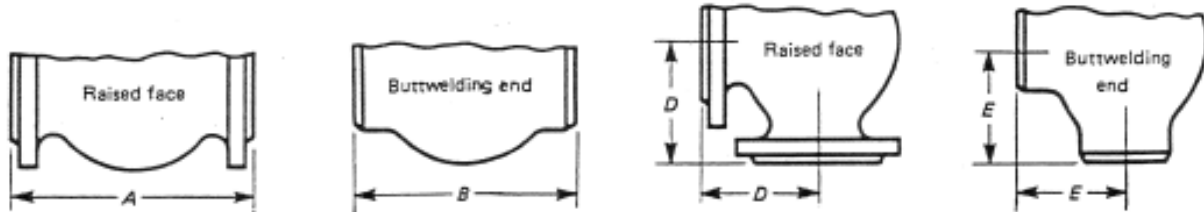


TABLE 7 CLASS 2500 STEEL FLANGED AND BUTTWELDING END VALVES, FACE-TO-FACE AND END-TO-END DIMENSIONS

Nominal Valve Size, NPS	1	2	3	4	5	6	7
	Class 2500 Steel						
	Flanged End (0.25 in. Raised Face) and Welding End						
	Gate		Plug, Regular Pattern A and B	Globe, Lift Check, and Swing Check, Long Pattern A and B	Globe, Lift Check, and Swing Check, Short Pattern (1) B	Angle and Lift Check, Long Pattern D and E	Ball
	Solid Wedge and Double Disc, Long Pattern A and B	Short Pattern (1) B					Long Pattern A and B
1/2	10.38 (2)	10.38	...	5.19	...
3/4	10.75 (2)	10.75	...	5.38	...
1	12.12 (2)	7.31	12.12	12.12	...	6.06	...
1 1/4	13.75 (2)	9.12	...	13.75	...	6.88	...
1 1/2	15.12 (2)	9.12	15.12	15.12	...	7.56	...
2	17.75	11.00	17.75	17.75	11.00	8.88	17.75
2 1/2	20.00	13.00	20.00	20.00	13.00	10.00	20.00
3	22.75	14.50	22.75	22.75	14.50	11.38	22.75
4	26.50	18.00	26.50	26.50	18.00	13.25	26.50
5	31.25	21.00	31.25	31.25	21.00	15.62	...
6	36.00	24.00	36.00	36.00	24.00	18.00	36.00
8	40.25	30.00	40.25	40.25	30.00	20.12	40.25
10	50.00	36.00	50.00	50.00	36.00	25.00	50.00
12	56.00	41.00	56.00	56.00	41.00	28.00	56.00
14	...	44.00
16	...	49.00
18	...	55.00

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) See Table 10 for adjustments to tabulated dimensions which may be required for certain flange facings.

NOTES:

- (1) These dimensions apply to pressure seal or flangeless bonnet valves. They may be applied at the manufacturer's option to valves with flanged bonnets.
- (2) Solid wedge only.

TABLE 8 CLASSES 125 AND 250 CAST IRON AND CLASSES 150 TO 2500 STEEL WAFER TYPE VALVES, FACE-TO-FACE DIMENSIONS

Nom. Valve Size, NPS	Steel																	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16		
	Steel (1)	Cast Iron (2)																
	Bonnetless Knife Gate, Class 150 Flange Mating Dimensions	Swing Check, Single and Dual Plate, Installation Between Standard ANSI Flanges (3)																
Class																		
Long Pattern (4)								Short Pattern (5)										
	Class		250		150	300	400	600	900	1500	2500	150	300	400	600	800	1500	
2	1.88	2.12	2.12	2.12	2.38	2.38	2.38	2.38	2.75	2.75	2.75	2.75	0.75	0.75	0.75	0.75	0.75	0.75
2½	...	2.38	2.38	2.62	2.62	2.62	2.62	2.62	3.25	3.25	3.25	3.25	0.75	0.75	0.75	0.75	0.75	0.75
3	2.00	2.62	2.62	2.88	2.88	2.88	2.88	3.12	3.25	3.25	3.38	3.38	0.75	0.75	0.75	0.75	0.75	0.88
4	2.00	2.62	2.62	2.88	2.88	2.88	3.12	3.12	4.00	4.00	4.12	4.12	0.75	0.75	0.88	0.88	0.88	1.25
5	2.25	3.25	3.25
6	2.25	3.75	3.75	3.88	3.88	3.88	5.38	5.38	6.25	6.25	6.25	6.25	0.88	0.88	1.00	1.12	1.38	1.75
8	2.75	5.00	5.00	5.00	5.00	5.00	6.50	6.50	8.12	8.12	8.12	8.12	1.12	1.12	1.25	1.50	1.75	2.25
10	2.75	5.50	5.50	5.75	5.75	5.75	8.38	8.38	9.50	9.75	10.00	10.00	1.12	1.12	2.00	2.25	2.25	2.88
12	3.00	7.12	7.12	7.12	7.12	7.12	9.00	9.00	11.50	12.00	12.00	12.00	1.50	2.00	2.25	2.38
14	3.00	7.25	8.75	7.25	8.75	10.75	10.75	10.75	14.00	14.00	1.75	2.00	2.50	2.62
16	3.50	7.50	9.12	7.50	9.12	12.00	12.00	12.00	15.12	15.12	2.00	2.00	2.50	2.88
18	3.50	8.00	10.38	8.00	10.38	14.25	14.25	14.25	17.75	18.44	2.38	3.00	3.25	3.25
20	4.50	8.38	11.50	8.62	11.50	14.50	14.50	14.50	17.75	21.00	2.50	3.25	3.50	3.62
24	4.50	8.75	12.50	8.75	12.50	15.50	15.50	17.25	19.50	22.00
30	...	12.00	14.50	12.00	14.50	18.12	18.12	19.88
36	...	14.50	19.00	14.50	19.00	25.00	25.00	25.00
42	...	17.00	22.38	17.00	22.38	27.62	27.62	27.62
48	...	20.62	24.75	20.62	24.75

GENERAL NOTES:

- (a) Dimensions are in inches.
 - (b) The tolerances of para. 5.1 apply to face-to-face dimensions for sizes NPS 24 and smaller. For sizes NPS 30 and larger, the tolerance shall be ±0.25 in.
- NOTES:**
- (1) These data for knife gate valves are extracted from TAPPI TIS 405-8 and MSS SP-81.
 - (2) These data for cast iron swing check valves are extracted from API 594.
 - (3) Valves of sizes NPS 30 and larger in Classes 150, 300, 400, and 600 shall have body outside diameters and gasket surface dimensions compatible with flange standards specified in the purchase order, e.g., API 605 or MSS SP-44.
 - (4) These data for long pattern steel swing check valves in sizes NPS 24 and smaller are extracted from API 6D and API 594. Data for larger sizes are extracted from API 594.
 - (5) These data for short pattern steel swing check valves are extracted from API 6D.

TABLE 9 CLASSES 25 AND 125 CAST IRON AND CLASSES 150 TO 600 STEEL BUTTERFLY VALVES, FACE-TO-FACE DIMENSIONS

Nom. Valve Size, NPS	1	2	3	4	5	6	7	8	9
	Cast Iron and Class 150 Steel (2)(3)(4)					Steel Grooved End (2)(4)	Steel Offset Seat Lug and Wafer Style (5)(6)		
	Flanged End		Lug and Wafer Style (1)			Class 150	Class 150	Class 300	Class 600
	Narrow	Wide	Narrow	Wide	Extra Wide				
1½	1.31	1.44	1.50	3.38
2	1.69	1.75	1.81	3.19
2½	1.81	1.94	2.00	3.81
3	5.00	5.00	1.81	1.94	2.00	3.81	1.88	1.88	2.12
4	5.00	7.00	2.06	2.19	2.25	4.56	2.12	2.12	2.50
5	5.00	7.50	2.19	2.50	2.56	5.81
6	5.00	8.00	2.19	2.75	2.81	5.81	2.25	2.31	3.06
8	6.00	8.50	2.38	2.81	2.94	5.25	2.50	2.88	4.00
10	8.00	15.00	2.69	3.00	3.12	6.25	2.81	3.25	4.62
12	8.00	15.00	3.06	3.25	3.38	6.50	3.19	3.62	5.50
14	8.00	16.00	3.06	3.62	3.75	7.00	3.62	4.62	6.12
16	8.00	16.00	3.12	4.00	4.12	7.00	4.00	5.25	7.00
18	8.00	16.00	4.00	4.50	4.62	8.00	4.50	5.88	7.88
20	8.00	18.00	4.38	5.00	5.12	8.50	5.00	6.25	8.50
24	8.00	18.00	...	6.06	6.19	10.00	6.06	7.12	9.13
30	12.00	22.00	...	6.50
36	12.00	22.00	...	7.88
42	12.00	24.00	...	9.88
48	15.00	26.00	...	10.88
54	15.00	28.00
60	15.00	30.00
66	18.00	34.00
72	18.00	36.00

GENERAL NOTE: Dimensions are in inches.

NOTES:

- (1) The installed face-to-face dimension is the dimension of the valve face-to-face after installation in the pipeline. It does not include the thickness of gaskets where separate gaskets are used. It does include the compressed (installed) thickness of gaskets or seals that are an integral part of the valve.
- (2) These butterfly valves are of the design generally having concentric location of disc and seat, covered by MSS SP-67, from which these data are extracted.
- (3) These valves are dimensionally compatible with flanges conforming to ASME/ANSI B16.1 Class 25 or Class 125, ASME/ANSI B16.5 Class 150, ASME B16.24 Class 150, ASME/ANSI B16.42 Class 150, or AWWA C-207.
- (4) For these butterfly valves, a tolerance of ± 0.06 in. shall be allowed on face-to-face dimensions of valves of NPS 6 and smaller, and a tolerance of ± 0.13 in. on NPS 8 and larger, except that for single flange and flangeless valves of NPS 30 and larger, a tolerance of ± 0.25 in. shall be allowed.
- (5) For these valves, a tolerance of ± 0.13 in. shall be allowed on the face-to-face dimensions for all sizes and pressure classes.
- (6) The data for offset seat valves, columns 7-9, are extracted from MSS SP-68 and API 609 (except 16"-24" Class 600, which are only in MSS SP-68).

TABLE 10 DETERMINATION OF FACE-TO-FACE AND END-TO-END DIMENSIONS OF FLANGED VALVES HAVING VARIOUS FLANGE FACINGS

Material	Class	Flat Face	Face-to-Face (1 - 3)				End-to-End (1 - 3)		
			0.06 in. Raised Face	0.25 in. Raised Face	Large or Small		Ring Type Joint	Large or Small	
					Male Face	Tongue Face		Female Face	Groove Face
Cast iron	125	(4)
	250	...	(4)
	800	(4)	(6), (7)	-0.12 (7)	...
Steel	150	(5)	(4)	...	+0.50	+0.50	(8)	+0.38	+0.38
	300	(5)	(4)	...	+0.50	+0.50	(8)	+0.38	+0.38
	400 to 2500	(4)	(6)	(6)	(8)	-0.12	-0.12

NOTES:

- (1) Dimensions are in inches.
- (2) To determine the face-to-face or end-to-end dimensions of valves having both flanges as tabulated in this table, adjust the face-to-face (not the butt-weld end-to-end) dimensions shown for the valve type (gate, globe, etc.), material, class, and size in Tables 1 to 7 by the amount shown.
- (3) For center-to-face or center-to-end dimensions of angle type valves, use one-half the numerical adjustment shown herein.
- (4) These face-to-face dimensions are listed in Tables 1 to 7. (See table of desired class.)
- (5) For Class 150 and for Class 300 steel valves having flat faces, either the full thickness of the flange or the thickness with the 0.06 in. raised face removed may be supplied unless otherwise specified. For full thickness of flange, the face-to-face dimensions listed for 0.06 in. raised face apply. Users are reminded that removing the 0.06 in. raised faces will make the face-to-face dimensions nonstandard.
- (6) These face-to-face dimensions are those listed for 0.25 in. raised face in Tables 3 to 7.
- (7) When used for Class 800 cast iron, applies to large face only.
- (8) The X dimensions given in Table 11 added to the appropriate raised face flange face-to-face dimensions of Tables 1 to 7 establish the end-to-end dimensions of steel valves having flanges with ring joint facings.

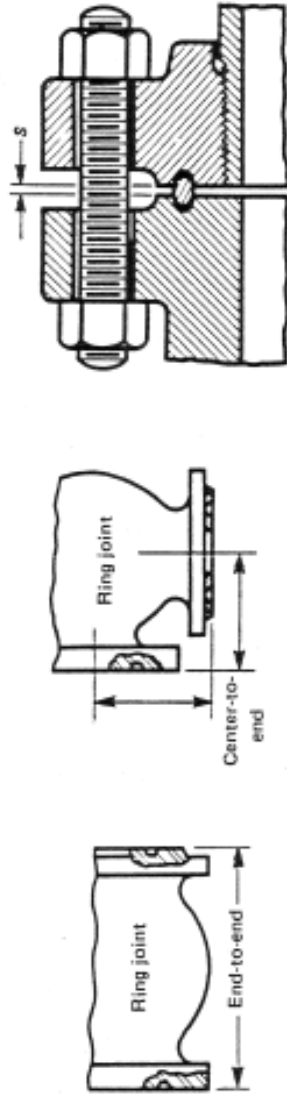


TABLE 11 CLASSES 150 TO 2500 STEEL VALVES HAVING END FLANGES WITH RING JOINT FACINGS, END-TO-END DIMENSIONS

Norm. Valve Size, NPS	Class 150		Class 300		Class 400		Class 600		Class 900		Class 1500		Class 2500	
	X	S	X	S	X	S	X	S	X	S	X	S	X	S
1/2	...	0.16	0.12	0.12	0.12	0.12	0.12	0.12	0.16	0.16	0	0.16	0	0.16
3/4	...	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0	0.16	0	0.16
1	0.50	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0	0.16	0	0.16
1 1/4	0.50	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0	0.16	0.12	0.12
1 1/2	0.50	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0	0.16	0.12	0.12
2	0.50	0.16	0.22	0.22	0.19	0.19	0.19	0.19	0.12	0.12	0.12	0.12	0.12	0.12
2 1/2	0.50	0.16	0.62	0.22	0.19	0.19	0.19	0.19	0.12	0.12	0.12	0.12	0.25	0.12
3	0.50	0.16	0.62	0.22	0.19	0.19	0.19	0.19	0.12	0.12	0.12	0.12	0.25	0.12
4	0.50	0.16	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.12	0.12	0.38	0.16
5	0.50	0.16	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.12	0.12	0.50	0.16
6	0.50	0.16	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.25	0.12	0.50	0.16
8	0.50	0.16	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.38	0.16	0.62	0.19
10	0.50	0.16	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.38	0.16	0.88	0.25
12	0.50	0.16	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.62	0.19	0.88	0.31
14	0.50	0.12	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.75	0.22
16	0.50	0.12	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.88	0.31
18	0.50	0.12	0.62	0.22	0.22	0.22	0.22	0.22	0.12	0.12	0.88	0.31
20	0.50	0.12	0.75	0.22	0.22	0.22	0.22	0.22	0.19	0.19	0.88	0.38
22	0.50 (1)	(2)	0.88 (1)	0.25	0.25	0.25	0.22	0.22	0.50	0.19	0.88	0.38
24	0.50	0.12	0.88	0.25	0.25	0.25	0.22	0.22	0.75	0.22	1.12	0.44

TABLE 11 CLASSES 150 TO 2500 STEEL VALVES HAVING END FLANGES WITH RING JOINT FACINGS, END-TO-END DIMENSIONS (CONT'D)

Nom. Valve Size, NPS	1	2	3	4	5	6	7	8	9	10	11	12	13	14	
	Class 150		Class 300			Class 400		Class 600		Class 900		Class 1500		Class 2500	
	X	S	X	S	X	S	X	S	X	S	X	S	X	S	
26	1.00 (1)	0.25	0.50 (1)	(2)	0.50 (1)	0.22	
28	1.00 (1)	0.25	0.50 (1)	(2)	0.50 (1)	0.22	
30	1.00 (1)	0.25	0.50 (1)	(2)	0.50 (1)	0.22	
32	1.12 (1)	(2)	0.62 (1)	(2)	0.62 (1)	(2)	
34	1.12 (1)	(2)	0.62 (1)	(2)	0.62 (1)	(2)	
36	1.12 (1)	(2)	0.62 (1)	(2)	0.62 (1)	(2)	

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) Flanges conform to those of ASME/ANSI B16.5 for the corresponding size and pressure class, except in NPS 22, NPS 26, and larger sizes. See Note (1).
- (c) To determine the end-to-end dimensions of valves having flanges with ring joint facings, the X dimensions must be added to the nominal raised face flange face-to-face dimensions of Tables 1 to 7. For angle and angle lift check valves, one-half of the X dimensions as listed in this table must be added to the nominal dimensions for center-to-end dimensions.
For approximate distance between ends of flanges having octagonal or oval ring gaskets, when rings are compressed, use S dimensions as listed in this table.

NOTES:

- (1) Flanges for NPS 22, NPS 26, and larger sizes conform to those of MSS SP-44 for the corresponding size and pressure class.
- (2) S dimension is not determined.
- (3) This dimension has a minus value because the height of the applicable ring joint face is 0.22 in., whereas the height of the raised face is 0.25 in.

ANNEX A REFERENCES

(This Annex is an integral part of ASME B16.10-1992 and is placed after the main text for convenience.)

The following is a list of standards and specifications referenced in this Standard, showing the applicable edition or year of approval.

API Publications

API 6D, Twentieth Edition	Pipeline Valves (Steel Gate, Plug, Ball, and Check Valves)
API 594, Fourth Edition	Wafer and Wafer-Lug Check Valves
API 609, Fourth Edition	Lug-and-Wafer-Type Butterfly Valves

ASME Publications

ASME/ANSI B16.1-1989	Cast Iron Pipe Flanges and Flanged Fittings, Class 25, 125, 250 and 800
ASME/ANSI B16.5-1988	Pipe Flanges and Flanged Fittings
ASME B16.24-1991	Cast Copper Alloy Pipe Flanges and Flanged Fittings, Class 150, 300, 400, 600, 900, 1500, and 2500
ASME/ANSI B16.34-1988	Valves — Flanged and Butt welding End — Steel, Nickel Alloy, and Other Special Alloys
ASME/ANSI B16.42-1987	Ductile Iron Pipe Flanges and Flanged Fittings, Class 150 and 300
ASME B16.47-1990	Large Diameter Steel Flanges NPS 26 through NPS 60

AWWA Publications

AWWA C207-86	Steel Pipe Flanges
--------------	--------------------

ISA Publications

ISA S75.03-1985	Face-to-Face Dimensions for Flanged Globe Style Control Valve Bodies
ANSI/ISA S75.04-1985	Face-to-Face Dimensions for Flangeless Control Valves

MSS Publications

MSS SP-44-1991	Steel Pipe Line Flanges
MSS SP-67-1990	Butterfly Valves
MSS SP-81-1981 (R 1991)	Stainless Steel Bonnetless, Flanged Knife Gate Valves

TAPPI Publications

TAPPI TIS 405-8-1981 Recommendations for Stainless Steel, Bonnetless,
Flanged, Wafer, and Knife Gate Valves

Publications of the following organizations appear on the above list:

API	American Petroleum Institute Production Department 2535 One Main Place Dallas, TX 75201-3688 American Petroleum Institute Refining Department 1220 L Street, N.W. Washington, D.C. 20005
ASME	The American Society of Mechanical Engineers 345 East 47th Street New York, NY 10017 ASME Order Department 22 Law Drive Box 2300 Fairfield, NJ 07007-2300
AWWA	American Water Works Association 6666 W. Quincy Avenue Denver, CO 80235
ISA	Instrument Society of America 67 Alexander Drive P. O. Box 12277 Research Triangle Park, NC 27709
MSS	Manufacturers Standardization Society of the Valve and Fittings Industry 127 Park Street, N.E. Vienna, VA 22180
TAPPI	Technical Association of the Pulp and Paper Industry Technology Park/Atlanta P. O. Box 105113 Atlanta, GA 30348

Publications appearing above which have been approved as American National Standards may also be obtained from:

ANSI	American National Standards Institute 11 West 42nd Street New York, NY 10036
------	--

INTERPRETATIONS TO ASME B16.10

(These interpretations are not part of ASME B16.10-1992 and are included for information only.)

INTRODUCTION

As a service to persons who use the B16 Standards, the B16 Committee renders interpretations of the requirements upon request. The procedure for requesting an interpretation is described in the following paragraphs.

The interpretations include all replies which have been approved by the B16 Main Committee in response to inquiries concerning interpretation of this Standard.

An interpretation applies either to the Edition and Addenda in effect on the date of issuance of the interpretation or the Edition and Addenda stated in the interpretation. Subsequent revisions to this Standard may supersede the interpretation.

PROCEDURE FOR REQUESTING INTERPRETATIONS

On request, the B16 Committee will render an interpretation of any requirement of this Standard. Interpretations can only be rendered in response to a written request, which should be addressed to:

Secretary, B16 Main Committee
The American Society of Mechanical Engineers
United Engineering Center
345 East 47th Street
New York, NY 10017

The request for interpretation should be clear and unambiguous. It is further recommended that the inquirer submit his request using the following format:

(a) *Subject.* Cite the applicable paragraph number(s) and/or give a concise description of the subject.

(b) *Question.* Phrase the question as a request for an interpretation of a specific requirement suitable for general understanding and use, not as a request for an approval of a proprietary design or situation. The inquirer may also include any plans or drawings which are necessary to explain the question; however, they should not contain proprietary names or information.

Requests which are not in this format may be rewritten in this format prior to being answered, which may inadvertently change the original intent of the request.

ASME procedures provide for reconsideration of an interpretation when or if additional information is available which the inquirer believes might affect the interpretation. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME committee or subcommittee. ASME does not "approve," "certify," "rate," or "endorse" any item, construction, proprietary device, or activity.